

Provided By:



# ALLOWABLE STRESS DESIGN OF PIER AND PANEL HIGHWAY SOUND BARRIER WALLS

## INTRODUCTION

Sound barrier walls are increasingly being used to reduce the impact of traffic noise on properties abutting major urban traffic routes. Because concrete masonry possesses many desirable features and properties—excellent sound resistance, low cost, design flexibility, structural capability and durability, it is an excellent material for the design and construction of highway sound barrier walls.

Aesthetics is also an important consideration. Noise barriers significantly impact a highway's visual impression. Visual qualities of noise barriers include overall shape, end conditions, color, texture, plantings and artistic treatment.

The variety of concrete masonry surface textures, colors and patterns has led to its extensive use in sound barrier walls.

Various types of concrete masonry walls may be used for sound barriers. Pier and panel walls are relatively easy to build and are economical due to the reduced thickness of the walls and the intermittent pier foundations. In addition, the piers can be offset with respect to the panels to achieve desired aesthetic effects. Pier and panel walls are also easily adapted to varying terrain conditions and are often used in areas that have expansive soils.

This TEK presents information on the structural design of concrete masonry pier and panel sound barrier walls. Requirements and considerations for reduction of highway traffic noise are discussed in TEK 13-03A, *Concrete Masonry Highway Sound Barriers* (ref. 2).

## DESIGN

*Building Code Requirements for Masonry Structures*, ACI 530/ASCE 5/TMS 402 (ref. 1) includes requirements for allowable stress design, strength design and prestressed approaches. The allowable stress design approach was used to develop the designs in this TEK. Allowable stresses were increased by one-third, as permitted for load combinations which include wind or seismic loads. *ASD of Concrete Masonry (2012 IBC & 2011 MSJC)*, TEK 14-07C (ref. 4), describes the basic design approach.

## Materials and Workmanship

Since concrete masonry sound barrier walls are subject to a wide range of load conditions, temperatures and moisture conditions, the selection of proper materials and proper workmanship is very important to ensure durability and satisfactory structural performance. Accordingly, it is recommended that materials (concrete masonry units, mortar, grout and reinforcement) comply with applicable requirements contained in *Building Code Requirements for Masonry Structures* (ref. 1).

## Lateral Loads

Design lateral loads should be in accordance with those specified by local or state building and highway departments. If design lateral loads are not specified, it is recommended that they conform to those specified in *Minimum Design Loads for Buildings and Other Structures*, ASCE 7 (ref. 3). Wind and earthquake loads required in this standard are briefly described in the following paragraphs.

Design wind loads ( $F$ ) on sound barrier walls may be determined as follows:

$$w = \frac{F}{A_j} = q_z GC_f$$

For the wall designs in this TEK,  $G$  is taken as 0.85 and  $C_f$  as 1.2. The minimum wind load specified in ASCE 7 is 10 psf (479 Pa). For basic wind speeds of 85 mph (minimum), 90 mph, 100 mph, and 110 mph (53, 145, 161, and 177 kmph), the corresponding wind loads are listed in Table 1.

Earthquake loads ( $F$ ) on sound barrier walls may be determined as follows, considering the wall system as a reinforced masonry non-building structure (ref. 3):

$$F_p = \frac{S_{DS} W_p}{R/I_p}$$

Seismic loads for a range of conditions are listed in Table 3.

**Deflections**

Deflection considerations typically govern wall design for long spans and taller walls with greater lateral loads. Deflections are imposed to limit the development of vertical flexure cracks within the wall panel and horizontal flexure cracks near the base of the pier. The design information presented in this TEK is based on a maximum allowable deflection of  $L/240$ , where  $L$  is the wall span between piers.

**DESIGN TABLES**

Design information for pier and panel walls is presented in Tables 4 through 7. Tables 4 and 5 provide horizontal reinforcing steel requirements for 6 in. and 8 in. (152 and 203 mm) panels, respectively. Horizontal reinforcement requirements can be met using either joint reinforcement or bond beams with reinforcing bars.

Table 6 provides pier size and reinforcement requirements for various lateral loads. Table 7 lists minimum sizes for pier foundations, as well as minimum embedment depths. These components of pier and panel walls are illustrated in Figure 1.

When pier and panels are used, walls are considered as deep beams, spanning horizontally between piers. Walls support their own weight, vertically, and also must resist lateral out-of-plane wind or seismic loads. The panels are built to be independent

of the piers to accommodate masonry unit shrinkage and soil movement. For this design condition, wall reinforcement is located either in the horizontal bed joints or in bond beams. Wall reinforcement is based on maximum moments ( $M$ ) and


**Table 1— Wind Loads for Sound Barrier Walls**

V, mph (km/h)	w, psf (Pa), for exposure category		
	B <sup>a</sup>	C <sup>b</sup>	D <sup>c</sup>
85 (53)	10 (479)	12.6 (601)	15.1 (772)
90 (145)	10 (479)	14.1 (674)	16.9 (809)
100 (161)	11.3 (540)	17.4 (832)	20.9 (999)
110 (177)	13.6 (653)	21.0 (1007)	25.2 (1208)

<sup>a</sup> Urban and suburban areas, wooded areas or other terrain with numerous closely spaced obstructions having the size of single-family dwellings or larger, not on a hill or escarpment.

<sup>b</sup> Open terrain with scattered obstructions having heights generally less than 30 ft (9.1 m); includes flat open country, grasslands and all water surfaces in hurricane-prone regions, not on a hill or escarpment.

<sup>c</sup> Flat, unobstructed areas and water surfaces outside hurricane-prone regions; includes smooth mud flats, salt flats and unbroken ice, not on a hill or escarpment.

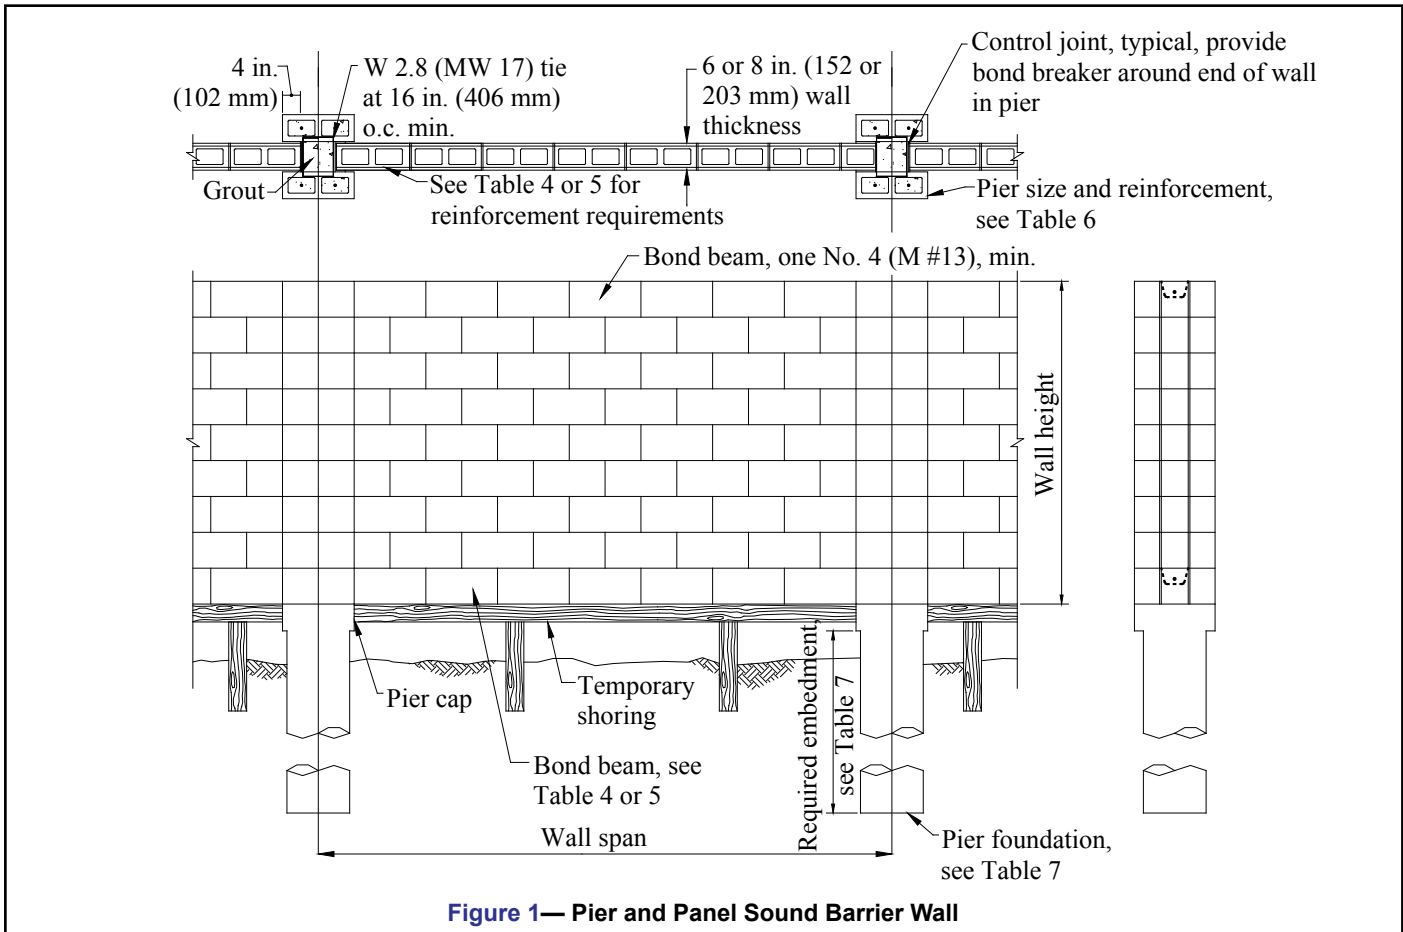

**Figure 1— Pier and Panel Sound Barrier Wall**

shears ( $V$ ) in the wall panels, determined as follows:

$$M = 0.125wL^2 \quad V = 0.5wL$$

The wall panels themselves are analyzed as simply supported beams, spanning from pier to pier.

In addition to the horizontal reinforcement, which transfers lateral loads to the piers, vertical reinforcement in the panels is required in Seismic Design Categories (SDC) C, D, E and F. *Building Code Requirements for Masonry Structures* (ref. 1) includes minimum prescriptive reinforcement as follows. In SDC C, vertical No. 4 (M #13) bars are located within 8 in. (203 mm) of the wall ends, and at 10 ft (3.0 m) on center along the length of the wall; minimum horizontal reinforcement requirements are satisfied by the primary reinforcement listed in Tables 4 and 5. In SDC D, E and F, vertical No. 4 (M #13) bars are located within 8 in. (203 mm) of the wall ends, and at 4 ft (1.22 m) on center along the length of the wall.

Table 6 shows pier size and vertical reinforcement requirements. Piers are designed as vertical cantilevers, not bonded with the walls, and pier reinforcement is based on maximum moment and shear, determined as follows:

$$M = 0.5wLH^2 \quad V = wLH$$

Design assumptions for the pier and panel walls are given in Table 2. Note that allowable stresses were increased by one-third, as permitted for load combinations which include wind or seismic loads (ref. 1).

Requirements for concrete foundations supporting the concrete

masonry piers are given in Table 7. These foundations can be constructed economically by drilling. The concrete foundation piers should contain vertical reinforcement (same as shown in Table 6) which should be properly lapped with vertical reinforcement in the concrete masonry piers. The embedment depths given in Table 7 are based on an allowable lateral passive soil pressure of 300 psf (14.4 kPa).

**DESIGN EXAMPLE**

A pier and panel highway sound barrier is to be designed using the following parameters:

- 6 in. (152 mm) panel thickness
- 10 ft (3.05 m) wall height
- 14 ft (4.27 m) wall span

Table 2— Design Assumptions for Tables 4, 5, and 6	
$f'_m$	= 1500 psi (10.34 MPa)
$F_m$	= $0.33f'_m(1.33)$ = 665 psi (4.58 MPa)
$F_v$	= $\sqrt{f'_m}(1.33)$ = 51.5 psi (0.36 MPa)
$E_m$	= $900(f'_m)$ = 1,350,000 psi (9,310 MPa)
$F_s$	= $24,000(1.33)$ = 31,920 psi (220.1 MPa) (bond beam and pier reinforcement)
$F_s$	= $30,000(1.33)$ = 39,900 psi (275.1 MPa) (joint reinforcement)
$n$	= $E_s/E_m$ = 21.5

Table 2— Seismic Loads for Sound Barrier Walls							
Wall thickness, in. (mm)	Grout spacing, in. (mm)	Seismic force, $F_p$ , psf (kPa), for short period spectral response acceleration, $S_s$ , of:					
		0.25	0.5	0.75	1.0	1.25	2.0
6 (152)	48 (1219)	2.8 (0.13)	4.9 (0.23)	6.3 (0.30)	7.7 (0.37)	8.7 (0.42)	13.9 (0.67)
	24 (610)	3.2 (0.16)	5.7 (0.27)	7.3 (0.35)	8.9 (0.43)	10.1 (0.49)	16.2 (0.78)
	8 (203)	5.1 (0.24)	8.9 (0.43)	11.5 (0.55)	14.0 (0.67)	15.9 (0.76)	25.5 (1.22)
8 (203)	48 (1219)	3.6 (0.17)	6.4 (0.31)	8.2 (0.39)	10.0 (0.48)	11.4 (0.55)	18.2 (0.87)
	24 (610)	4.3 (0.21)	7.5 (0.36)	9.7 (0.46)	11.8 (0.57)	13.4 (0.64)	21.5 (1.03)
	8 (203)	6.9 (0.33)	12.1 (0.58)	15.6 (0.75)	19.0 (0.91)	21.6 (1.04)	34.6 (1.66)

Table 2—6 in. (152 mm) Panel Wall Reinforcement <sup>a</sup>									
Wall span, ft (m)	Reinforcement size and spacing, in. on center								Beam at bottom of panel (minimum depth/reinforcement)
	w = 10psf (479 Pa)		w = 15psf (718 Pa)		w = 20psf (958 Pa)		w = 25psf (1,197 Pa)		
	Joint reinf.	Bond beam	Joint reinf.	Bond beam	Joint reinf.	Bond beam	Joint reinf.	Bond beam	
10 (3.1)	W1.7 @ 16	No. 4 @ 48	W1.7 @ 16	No. 4 @ 48	W2.8 @ 16	No. 4 @ 48	W1.7 @ 8	No. 4 @ 48	8 in./1-No.5
12 (3.7)	W1.7 @ 16	No. 4 @ 48	W2.8 @ 16	No. 4 @ 48	W1.7 @ 8	No. 5 @ 48	W2.1 @ 8	No. 5 @ 48	16 in./2-No. 4
14 (4.3)	W2.8 @ 16	No. 4 @ 48	W1.7 @ 8	No. 5 @ 48	---	No. 5 @ 48	---	2- No. 5 @ 48	16 in./1-No. 5
16 (4.9)	W1.7 @ 8	No. 4 @ 48	W2.8 @ 8	No. 5 @ 48	---	2- No. 5 @ 48	---	2- No. 5 @ 16	24 in./1-No. 5
18 (5.5)	W2.1 @ 8	No. 5 @ 48	W2.8 @ 8	No. 6 @ 48	---	2- No. 5 @ 16	---	2- No. 5 @ 8	24 in./2-No. 4
20 (6.1)	W2.8 @ 8	No. 5 @ 48	---	No. 6 @ 16	---	No. 6 @ 16	---	2- No. 5 @ 8	40 in./2-No. 4

<sup>a</sup> Where values for joint reinforcement and bond beam reinforcement are both given, either may be selected. Assumed  $d$  values: 4.81 in. (122 mm) for joint reinforcement; 2.8 in. (71 mm) for bond beam. For other design assumptions, see Table 3.

**Table 5—8 in. (203 mm) Panel Wall Reinforcement<sup>a</sup>**  
Reinforcement size and spacing, in. on center

Wall span, ft (m)	w = 10psf (479 Pa)		w = 15psf (718 Pa)		w = 20psf (958 Pa)		w = 25psf (1,197 Pa)		Beam at bottom of panel (minimum depth/reinforcement)
	Joint reinf.	Bond beam	Joint reinf.	Bond beam	Joint reinf.	Bond beam	Joint reinf.	Bond beam	
10 (3.1)	W1.7 @ 16	No. 4 @ 48	W1.7 @ 16	No. 4 @ 48	W1.7 @ 16	No. 4 @ 48	W2.1 @ 16	No. 4 @ 48	8 in./2-No.4
12 (3.7)	W1.7 @ 16	No. 4 @ 48	W1.7 @ 16	No. 4 @ 48	W2.8 @ 16	No. 4 @ 48	W1.7 @ 8	No. 4 @ 48	16 in./1-No. 4
14 (4.3)	W1.7 @ 16	No. 4 @ 48	W2.8 @ 16	No. 4 @ 48	W1.7 @ 8	No. 5 @ 48	W2.8 @ 8	No. 5 @ 48	16 in./1-No. 5 <sup>b</sup>
16 (4.9)	W2.1 @ 16	No. 4 @ 48	W1.7 @ 8	No. 5 @ 48	W2.1 @ 8	No. 5 @ 48	W2.1 @ 8	No. 6 @ 48	24 in./1-No. 5 <sup>c</sup>
18 (5.5)	W2.8 @ 16	No. 4 @ 48	W2.1 @ 8	No. 5 @ 48	W2.8 @ 8	No. 6 @ 48	W2.8 @ 8	2- No. 6 @ 48	24 in./2-No. 4 <sup>d</sup>
20 (6.1)	W1.7 @ 8	No. 5 @ 48	W2.8 @ 8	No. 6 @ 48	---	No. 6 @ 48	---	2- No. 6 @ 48	32 in./2-No. 5

<sup>a</sup> Where values for joint reinforcement and bond beam reinforcement are both given, either may be selected. Assumed *d* values: 6.81 in. (173 mm) for joint reinforcement; 3.81 in. (97 mm) for single bar bond beams.; *d* = 5.0 in. (127 mm) for bond beams with two bars, although the area of only one bar was used to determine resisting moment. For other design assumptions, see Table 3.

<sup>b</sup> For 8 ft (2,430 mm) high wall, two No. 5 (M # 16) bars are required.

<sup>c</sup> For 8 and 10 ft (2,430 and 3,050 mm) high walls, two No. 4 (M # 13) bars are required.

<sup>d</sup> For 8 and 10 ft (2,430 and 3,050 mm) high walls, two No. 5 (M # 16) bars are required.

**Table 6—Pier Size and Reinforcement**

Reinforcement schedules: a = 4—No. 4; b = 4—No. 5; c = 4—No. 6; d = 4—No. 7; e = 4—No. 8; f = 6—No. 7; g = 6—No. 8

Pier sizes, in. x in.: A = 16 x 18; B = 16 x 20; C = 16 x 22; D = 16 x 24; E = 16 x 26; F = 16 x 28; G = 24 x 22; H = 24 x 24; I = 24 x 26; J = 24 x 28

**w = 10 psf** Pier reinforcement (reinforcement schedule/pier size) for wall height, ft, of:

Wall span, ft	For 6-inch wall panels:								For 8-inch wall panels:							
	6	8	10	12	14	16	18	20	6	8	10	12	14	16	18	20
10	a/A	a/A	a/A	a/A	a/A	a/A	b/A	c/A	a/B	a/B	a/B	a/B	a/B	a/B	b/B	b/B
12	a/A	a/A	a/A	a/A	a/A	b/A	b/A	c/A	a/B	a/B	a/B	a/B	a/B	a/B	b/B	b/B
14	a/A	a/A	a/A	a/A	a/A	b/A	c/A	c/C	a/B	a/B	a/B	a/B	a/B	b/B	b/B	c/B
16	a/A	a/A	a/A	a/A	b/A	b/A	c/A	c/C	a/B	a/B	a/B	a/B	b/B	b/B	c/B	c/B
18	a/A	a/A	a/A	a/A	b/A	c/A	c/C	c/C	a/B	a/B	a/B	a/B	b/B	b/B	c/B	c/D
20	a/A	a/A	a/A	b/A	b/A	c/A	c/C	d/C	a/B	a/B	a/B	a/B	b/B	c/B	c/D	c/D

**w = 15 psf** Pier reinforcement (reinforcement schedule/pier size) for wall height, ft, of:

Wall span, ft	For 6-inch wall panels:								For 8-inch wall panels:							
	6	8	10	12	14	16	18	20	6	8	10	12	14	16	18	20
10	a/A	a/A	a/A	a/A	b/A	b/A	c/A	c/C	a/B	a/B	a/B	a/B	a/B	b/B	b/B	c/B
12	a/A	a/A	a/A	a/A	b/A	c/A	c/C	c/C	a/B	a/B	a/B	a/B	b/B	b/B	c/B	c/D
14	a/A	a/A	a/A	b/A	b/A	c/A	c/C	e/C	a/B	a/B	a/B	a/B	b/B	c/B	c/D	c/D
16	a/A	a/A	a/A	b/A	c/A	c/C	d/C	d/E	a/B	a/B	a/B	b/B	b/B	c/B	c/D	d/D
18	a/A	a/A	a/A	b/A	c/A	c/C	e/C	e/E	a/B	a/B	a/B	b/B	c/B	c/D	d/D	d/F
20	a/A	a/A	b/A	c/A	c/C	d/C	d/E	f/G	a/B	a/B	a/B	b/B	c/B	c/D	d/D	d/F

**w = 20 psf** Pier reinforcement (reinforcement schedule/pier size) for wall height, ft, of:

Wall span, ft	For 6-inch wall panels:								For 8-inch wall panels:							
	6	8	10	12	14	16	18	20	6	8	10	12	14	16	18	20
10	a/A	a/A	a/A	b/A	b/A	c/A	c/C	d/C	a/B	a/B	a/B	a/B	b/B	c/B	c/B	c/D
12	a/A	a/A	a/A	b/A	c/A	c/C	d/C	d/E	a/B	a/B	a/B	b/B	b/B	c/B	c/D	d/D
14	a/A	a/A	b/A	b/A	c/C	c/C	d/E	e/E	a/B	a/B	a/B	b/B	c/B	c/D	d/D	d/F
16	a/A	a/A	b/A	c/A	c/C	c/E	d/E	g/G	a/B	a/B	b/B	c/B	c/D	c/D	d/F	e/F
18	a/A	a/A	b/A	c/A	c/C	d/E	f/G	f/I	a/B	a/B	b/B	c/B	c/D	d/D	d/F	f/H
20	a/A	a/A	b/A	c/C	d/C	d/E	g/G	g/I	a/B	a/B	b/B	c/B	c/D	e/D	e/F	g/H

**w = 25 psf** Pier reinforcement (reinforcement schedule/pier size) for wall height, ft, of:

Wall span, ft	For 6-inch wall panels:								For 8-inch wall panels:							
	6	8	10	12	14	16	18	20	6	8	10	12	14	16	18	20
10	a/A	a/A	a/A	b/A	c/A	c/C	d/C	d/E	a/B	a/B	a/B	b/B	b/B	c/B	c/D	e/D
12	a/A	a/A	b/A	c/A	c/C	d/C	d/E	f/G	a/B	a/B	a/B	b/B	c/B	c/D	d/D	d/F
14	a/A	a/A	b/A	c/A	c/C	e/C	e/E	f/I	a/B	a/B	b/B	b/B	c/D	d/D	d/F	f/H
16	a/A	a/A	b/A	c/C	d/C	d/E	g/G	g/I	a/B	a/B	b/B	c/B	c/D	e/D	e/F	g/H
18	a/A	b/A	c/A	d/C	d/E	f/G	f/I	---	a/B	a/B	b/B	c/B	d/D	e/F	f/H	f/J
20	a/A	b/A	c/A	d/C	d/E	---	---	---	a/B	b/B	c/B	c/D	d/D	e/F	f/J	g/J

Notes: Pier type and reinforcement is the minimum allowable for each wall span and height. Larger piers maybe designed and used. Pier dimensions are nominal dimensions. Design dimensions were assumed to be 3/8 in. (9.5 mm) less than the nominal dimensions. Assumed *d* is 2.5 in. (64 mm) less than the actual depth of the pier.

**Table 7—Pier Foundation Requirements, Minimum Embedment/Diameter<sup>a, b</sup>**

(T = 18 in. pier diam.; U = 20 in. pier diam.; X = 24 in. pier diam.; Y = 30 in. pier diam.; Z = 36 in. pier diam.)

Wall span, ft (m)	<b>w = 10 psf (479 Pa)</b> Wall height, ft (m)							
	6 (1.83)	8 (2.44)	10 (3.05)	12 (3.66)	14 (4.27)	16 (4.88)	18 (5.49)	20 (6.10)
10 (3.05)	4.0 ft/T	5.0 ft/T	5.5 ft/T	6.0 ft/T	6.5 ft/T <sup>c</sup>	7.0 ft/T <sup>c</sup>	7.5 ft/T <sup>c</sup>	8.0 ft/T <sup>c</sup>
12 (3.66)	4.5 ft/T	5.0 ft/T	6.0 ft/T	6.5 ft/T	7.0 ft/T <sup>c</sup>	7.5 ft/T <sup>c</sup>	8.5 ft/T <sup>c</sup>	9.0 ft/T <sup>c</sup>
14 (4.27)	4.5 ft/T	5.5 ft/T	6.0 ft/T	7.0 ft/T	7.0 ft/T <sup>c</sup>	8.0 ft/T <sup>c</sup>	9.0 ft/T <sup>c</sup>	9.5 ft/T <sup>c</sup>
16 (1.88)	5.0 ft/T	6.0 ft/T	6.5 ft/T	7.5 ft/T <sup>c</sup>	8.0 ft/T <sup>c</sup>	8.5 ft/T <sup>c</sup>	9.0 ft/T <sup>c</sup>	10.0 ft/T <sup>c</sup>
18 (5.49)	5.0 ft/T	6.0 ft/T	7.0 ft/T	7.5 ft/T <sup>c</sup>	8.5 ft/T <sup>c</sup>	9.0 ft/T <sup>c</sup>	9.5 ft/T <sup>c</sup>	10.5 ft/T <sup>c</sup>
20 (6.10)	5.5 ft/T	6.5 ft/T	7.0 ft/T	8.0 ft/T <sup>c</sup>	8.5 ft/T <sup>c</sup>	9.5 ft/T <sup>c</sup>	10.0 ft/T <sup>c</sup>	10.5 ft/T <sup>c</sup>
Wall span, ft (m)	<b>w = 15 psf (718 Pa)</b> Wall height, ft (m)							
	6 (1.83)	8 (2.44)	10 (3.05)	12 (3.66)	14 (4.27)	16 (4.88)	18 (5.49)	20 (6.10)
10 (3.05)	5.0 ft/T	5.5 ft/T	6.5 ft/T	7.0 ft/T	8.0 ft/T	8.5 ft/T	9.0 ft/T <sup>c</sup>	9.5 ft/T <sup>c</sup>
12 (3.66)	5.0 ft/T	6.0 ft/T	7.0 ft/T	7.5 ft/T	8.5 ft/T	9.0 ft/T	9.5 ft/T <sup>c</sup>	10.5 ft/T <sup>c</sup>
14 (4.27)	5.5 ft/T	6.5 ft/T	7.5 ft/T	8.0 ft/T	9.0 ft/T	9.5 ft/T <sup>c</sup>	10.5 ft/T <sup>c</sup>	11.0 ft/T <sup>c</sup>
16 (1.88)	6.0 ft/T	7.0 ft/T	7.5 ft/T	8.5 ft/T	9.5 ft/T	10.0 ft/T <sup>c</sup>	11.0 ft/T <sup>c</sup>	11.5 ft/T <sup>c</sup>
18 (5.49)	6.0 ft/T	7.0 ft/T	8.0 ft/T	9.0 ft/T	10.0 ft/T <sup>c</sup>	10.5 ft/T <sup>c</sup>	11.5 ft/T <sup>c</sup>	11.5 ft/U <sup>c</sup>
20 (6.10)	6.5 ft/T	7.5 ft/T	8.5 ft/T	9.5 ft/T	10.0 ft/T <sup>c</sup>	11.0 ft/T <sup>c</sup>	11.5 ft/U <sup>c</sup>	12.0 ft/U <sup>c</sup>
Wall span, ft (m)	<b>w = 20 psf (958 Pa)</b> Wall height, ft (m)							
	6 (1.83)	8 (2.44)	10 (3.05)	12 (3.66)	14 (4.27)	16 (4.88)	18 (5.49)	20 (6.10)
10 (3.05)	5.5 ft/T	6.5 ft/T	7.0 ft/T	8.0 ft/T	8.5 ft/T	9.5 ft/T	10.0 ft/T	10.5 ft/T
12 (3.66)	6.0 ft/T	7.0 ft/T	7.5 ft/T	8.5 ft/T	9.5 ft/T	10.0 ft/T	11.0 ft/T	11.5 ft/T
14 (4.27)	6.0 ft/T	7.0 ft/T	8.0 ft/T	9.0 ft/T	10.0 ft/T	10.5 ft/T	11.5 ft/T	11.5 ft/U
16 (1.88)	6.5 ft/T	7.5 ft/T	8.5 ft/T	9.5 ft/T	10.5 ft/T	11.5 ft/T	11.5 ft/U	11.5 ft/X
18 (5.49)	7.0 ft/T	8.0 ft/T	9.0 ft/T	10.0 ft/T	11.0 ft/T	11.5 ft/U	12.0 ft/U	12.0 ft/X
20 (6.10)	7.0 ft/T	8.5 ft/T	9.5 ft/T	10.5 ft/T	11.5 ft/T	12.0 ft/U	12.0 ft/X	11.5 ft/Y
Wall span, ft (m)	<b>w = 25 psf (1197 Pa)</b> Wall height, ft (m)							
	6 (1.83)	8 (2.44)	10 (3.05)	12 (3.66)	14 (4.27)	16 (4.88)	18 (5.49)	20 (6.10)
10 (3.05)	6.0 ft/T	7.0 ft/T	8.0 ft/T	8.5 ft/T	9.5 ft/T	10.5 ft/T	11.0 ft/T	11.5 ft/T
12 (3.66)	6.5 ft/T	7.5 ft/T	8.5 ft/T	9.5 ft/T	10.0 ft/T	11.0 ft/T	11.5 ft/U	12.0 ft/U
14 (4.27)	6.5 ft/T	8.0 ft/T	9.0 ft/T	10.0 ft/T	11.0 ft/T	11.5 ft/U	12.0 ft/U	12.0 ft/X
16 (1.88)	7.0 ft/T	8.5 ft/T	9.5 ft/T	10.5 ft/T	11.5 ft/T	12.0 ft/U	12.0 ft/X	11.5 ft/Y
18 (5.49)	7.5 ft/T	9.0 ft/T	10.0 ft/T	11.0 ft/T	11.5 ft/U	11.5 ft/X	11.5 ft/Y	12.0 ft/Y
20 (6.10)	8.0 ft/T	9.0 ft/T	10.5 ft/T	11.5 ft/T	12.0 ft/U	12.0 ft/X	12.0 ft/Y	11.5 ft/Z

<sup>a</sup> Pier reinforcement must be designed to resist moments and shears from the masonry piers above. Required embedment depth was calculated using the following formula with an allowable lateral soil bearing pressure of 300 psf per foot of embedment (47.1 kPa/m), increased by one-third for load combinations including wind or seismic.

$$d = \frac{A}{2} \left( 1 + \sqrt{1 + \frac{4.36h}{A}} \right), \text{ where: } A = \frac{2.34P}{(S_l b)} \qquad b = \text{diameter of foundation pier, ft (m)}$$

- $P$  = applied lateral force, lb (N)       $d$  = depth of embedment, ft (m)
- $h$  = distance from the ground surface to the point of application of  $P$  (one-half the height of the wall), ft (m)
- $S_l$  = allowable lateral soil-bearing pressure based on a depth of one-third the depth of embedment, psf (kPa)

Vertical load capacity was based on 2000 psf (95.8 kPa) soil bearing capacity and 300 psf (14.4 kPa) skin friction between the soil and drilled shafts.

<sup>b</sup> If soil conditions warrant, the wall could alternatively be supported by a continuous 8 in. thick by 16 in. wide (203 by 406 mm) foundation between the drilled shaft foundations. This option precludes the need for the bond beam at the bottom of the wall.

<sup>c</sup> Increase the pier diameter where indicated by 6 in. (152 mm) if the drilled shaft foundations are used to fully support the wall weight.

- open terrain, stiff soil
- basic wind speed is 90 mph (145 km/h)
- $S_s = 0.25$ , SDC B

From Table 1, the design wind load is 14.1 psf (674 Pa) for a basic wind speed of 90 mph (145 km/h) and exposure C. Using Table 3, the design seismic load is determined to be 2.8 psf (0.13 kPa) for a 6 in. (152 mm) wall grouted at 48 in. (1219 mm), or less, on center, for  $S_s = 0.25$ . Since the wind load is greater, the wall will be designed for 14.1 psf (674 Pa).

Using Table 4, minimum horizontal panel reinforcement is either W1.7 (MW 11) joint reinforcement at 8 in. (203 mm) on center, or bond beams at 48 in. (1220 mm) on center reinforced with one No. 5 (M #16) bar. At the bottom, the panel requires a beam 16 in. (406 mm), or two courses, deep reinforced with one No. 5 (M # 16) bar (last column of Table 4). Because the wall is located in SDC B, vertical reinforcement is not required to meet prescriptive seismic requirements.

The minimum pier size is 16 x 18 in. (406 x 460 mm), reinforced with four No. 4 (M #13) bars, per Table 6. The pier foundation diameter is 18 in. (457 mm), and should be embedded at least 7.5 ft (2.29 m), per Table 7.

## NOTATIONS

- $A_f$  = area normal to wind direction, ft<sup>2</sup> (m<sup>2</sup>)  
 $C_f$  = force coefficient (see ref. 3)  
 $d$  = distance from extreme compression fiber to centroid of tension reinforcement, in. (mm)  
 $E_m$  = modulus of elasticity of masonry in compression, psi (MPa)  
 $E$  = modulus of elasticity of steel, psi (MPa)  
 $F$  = design wind load, psf (Pa) (see ref. 3)  
 $F_a$  = acceleration-based site factor (at 0.3 second period) (see ref. 3)  
 $F_m$  = allowable masonry flexural compression stress, psi (Pa)  
 $F_p$  = seismic force, psf (Pa) (see ref. 3)  
 $F_s$  = allowable tensile or compressive stress in reinforcement, psi (MPa)  
 $F_v$  = allowable shear stress in masonry, psi (MPa)  
 $f'_m$  = specified compressive strength of masonry, psi (MPa)  
 $G$  = gust effect factor (see ref. 3)  
 $H$  = wall height, ft (m)  
 $I$  = importance factor (see ref. 3)  
 $I_p$  = component importance factor (assume equal to 1.0 for sound barrier walls) (see ref. 3)  
 $K_d$  = wind directionality factor (see ref. 3)  
 $K_z$  = velocity pressure exposure coefficient (see ref. 3)  
 $K_{zt}$  = hill and escarpment factor (see ref. 3)  
 $L$  = wall span, ft (m)  
 $M$  = maximum moment at the section under consideration, in.-lb (N-mm)  
 $n$  = ratio of elastic moduli,  $E_s/E_m$   
 $P$  = applied lateral force, lb (N)  
 $q_z$  = velocity pressure, psf (Pa) (see ref. 3)  
 $= 0.00256K_z K_{zt} K_d v^2 I$   
 $R$  = response modification coefficient (see ref. 3)  
 $R_p$  = component response modification factor (equal to 3.0 for reinforced masonry non-building structures) (see ref. 3)  
 $S$  = design short period spectral acceleration =  $2/3(F_a S_s)$ , where  $S_s$  varies from less than 0.25 to greater than 1.25, and  $F_a$  is dependent on SS and soil conditions at the site (see ref. 3)  
 $S_s$  = mapped maximum considered earthquake spectral response acceleration at short periods (see ref. 3)  
 $V$  = shear force, lb (N)  
 $v$  = basic wind speed, mph (km/h) (see ref. 3)  
 $W_p$  = weight of wall, psf (Pa)  
 $w$  = wind or seismic load, psf (Pa)



## REFERENCES

1. *Building Code Requirements for Masonry Structures*, ACI 530-02/ASCE 5-02/TMS 402-02. Reported by the Masonry Standards Joint Committee, 2002.
2. *Concrete Masonry Highway Sound Barriers*, TEK 13-03A, Concrete Masonry & Hardscapes Association, 1999.
3. *Minimum Design Loads for Buildings and Other Structures*, ASCE 7-02. American Society of Civil Engineers, 2002.
4. *ASD of Concrete Masonry (2012 IBC & 2011 MSJC)*, TEK 14-07C, Concrete Masonry & Hardscapes Association, 2004.

## ABOUT CMHA

The Concrete Masonry & Hardscapes Association (CMHA) represents a unification of the Interlocking Concrete Pavement Institute (ICPI) and National Concrete Masonry Association (NCMA). CMHA is a trade association representing US and Canadian producers and suppliers in the concrete masonry and hardscape industry, as well as contractors of interlocking concrete pavement and segmental retaining walls. CMHA is the authority for segmental concrete products and systems, which are the best value and preferred choice for resilient pavement, structures, and living spaces. CMHA is dedicated to the advancement of these building systems through research, promotion, education, and the development of manufacturing guides, design codes and resources, testing standards, and construction practices.

### Disclaimer:

The content of this CMHA Tech Note is intended for use only as a guideline and is made available "as is." It is not intended for use or reliance upon as an industry standard, certification or as a specification. CMHA and those companies disseminating the technical information contained in the Tech Note make no promises, representations or warranties of any kind, expressed or implied, as to the accuracy or completeness of content contained in the Tech Note and disclaim any liability for damages or injuries resulting from the use or reliance upon the content of Tech Note. Professional assistance should be sought with respect to the design, specifications, and construction of each project.